
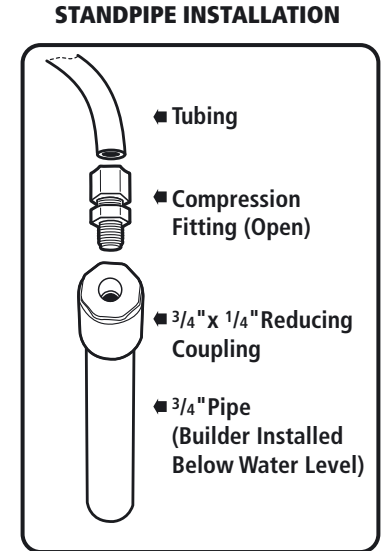


UltraPure Pool Ozone Generators Installation Schematics

(Shows Two Alternatives – the Retrofit and Stand Pipe Methods)

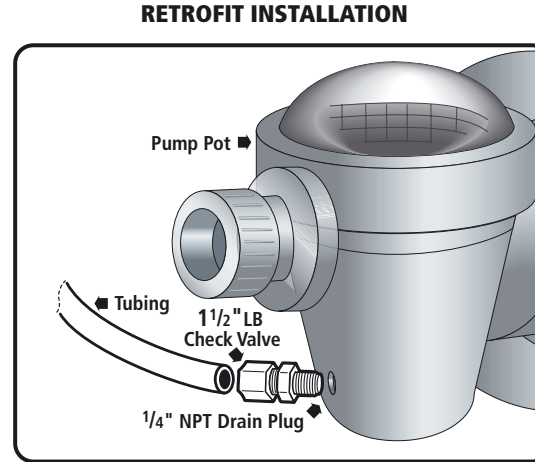

Notes

Standpipe Installation

- No Check Valve Required since the connection is below water level.
- Is Virtually Fail Safe.

Retrofit Installation

- Requires 1 1/2 Lb. Check Valve.
- Stronger Check Valve is required on installations over 3' above water level.

External Safety Air Bleed Kit

ESABK is designed to take air from the top of the filter and send it downstream (up to 15') past all equipment.

